


WATER CISTERNS METRIC UNITS


1 CLEAR ROOF & GUTTERS AND EMPTY CISTERN




2 MAKE DISINFECTING SOLUTION

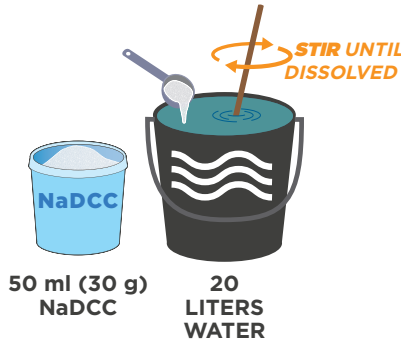

3 USE DISINFECTING SOLUTION TO SCRUB CISTERN. RINSE WITH PLAIN WATER.

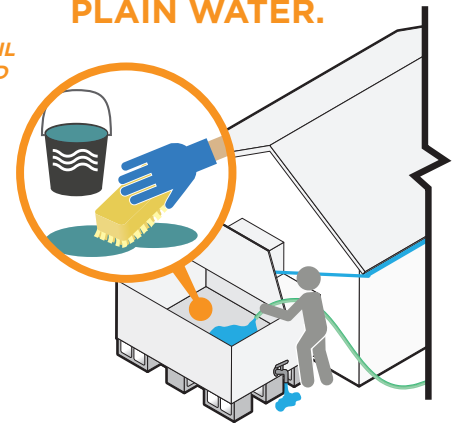


4 MAKE NEW SOLUTION. FILL CISTERN, ADD SOLUTION, AND LET SIT FOR 12 HOURS.

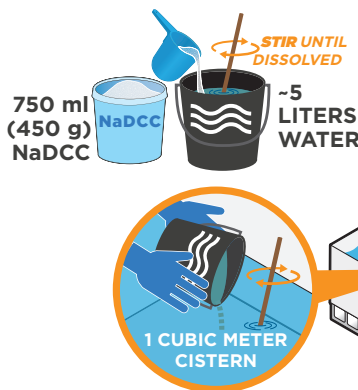

DO NOT USE THE WATER



5 EMPTY CISTERN

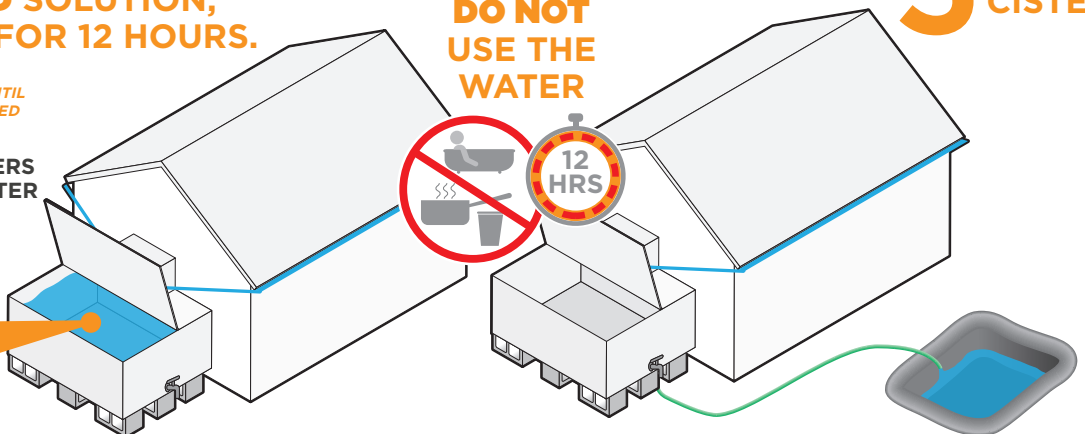

6 REFILL CISTERN

7 MAKE NEW SOLUTION AND ADD TO CISTERN.

8 MONITOR TO ENSURE A CHLORINE RESIDUAL

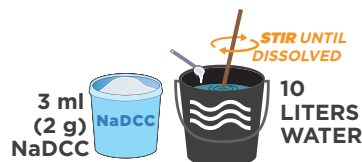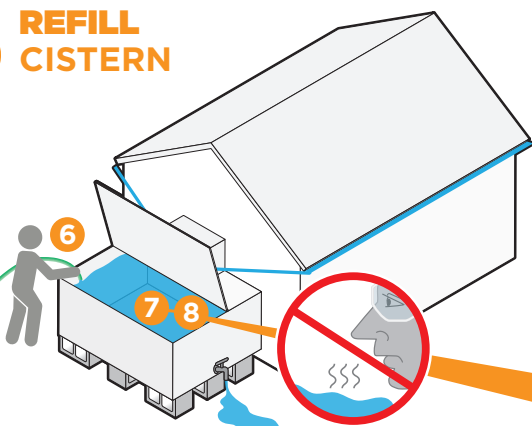

6 RUN UNTIL NO CHLORINE SMELL FROM WATER RUNNING OUT. FILL CISTERN.

